



Reduction Claim

| | |
|--|---|
| Sediments | ✓ |
| Chlorine | ✓ |
| Pesticides & Herbicides | ✓ |
| Volatile Organic Compounds | ✓ |
| Taste, Odours & Colour | ✓ |
| Heavy Metals (Copper, Arsenic, Mercury, Lead...) | ✓ |
| Parasites | ✓ |
| Bacteria & Viruses | ✗ |
| Fluorides | ✗ |
| Chloramines | ✗ |

Replacement Filters Bundle

SPECIFICATIONS

Dimensions: 270 W x 370 H x 130 D mm
 Flow Rate: 3 LPM
 Connects To: 1/2" Kitchen Faucet Spout
 Min. Working Pressure: 25 psi
 Max. Working Pressure: 125 psi
 Min. Operating Temperature: 0.6 °C
 Max. Operating Temperature: 38 °C

Note: Flush the system for a few minutes before use. This will remove non-toxic carbon fines and oxygen (air bubbles) from the new cartridges.

CHOICE OF FILTERS



Twin Benchtop with Sediment and Carbon

\$275



Twin Benchtop with Sediment and Aragon

\$349



Twin Benchtop with Fluoride and Aragon

\$423

| | | | |
|--|---|---|---|
| Sediments | ✓ | ✓ | ✓ |
| Chlorine | ✓ | ✓ | ✓ |
| Pesticides & Herbicides | ✓ | ✓ | ✓ |
| Volatile Organic Compounds | ✓ | ✓ | ✓ |
| Taste, Odours & Colour | ✓ | ✓ | ✓ |
| Heavy Metals (Copper, Arsenic, Mercury, Lead...) | ✓ | ✓ | ✓ |
| Parasites | ✓ | ✓ | ✓ |
| Bacteria & Viruses | ✗ | ✓ | ✓ |
| Fluorides | ✗ | ✗ | ✓ |
| Chloramines | ✗ | ✓ | ✓ |

\$75

\$125


\$209



Our systems are connected to your existing kitchen faucet and are supplied with an adaptor and a diverter to connect to your faucet.

DIY Installation

NOTE: An external thread on the faucet indicates a male fitting. An internal thread indicates a female fitting.

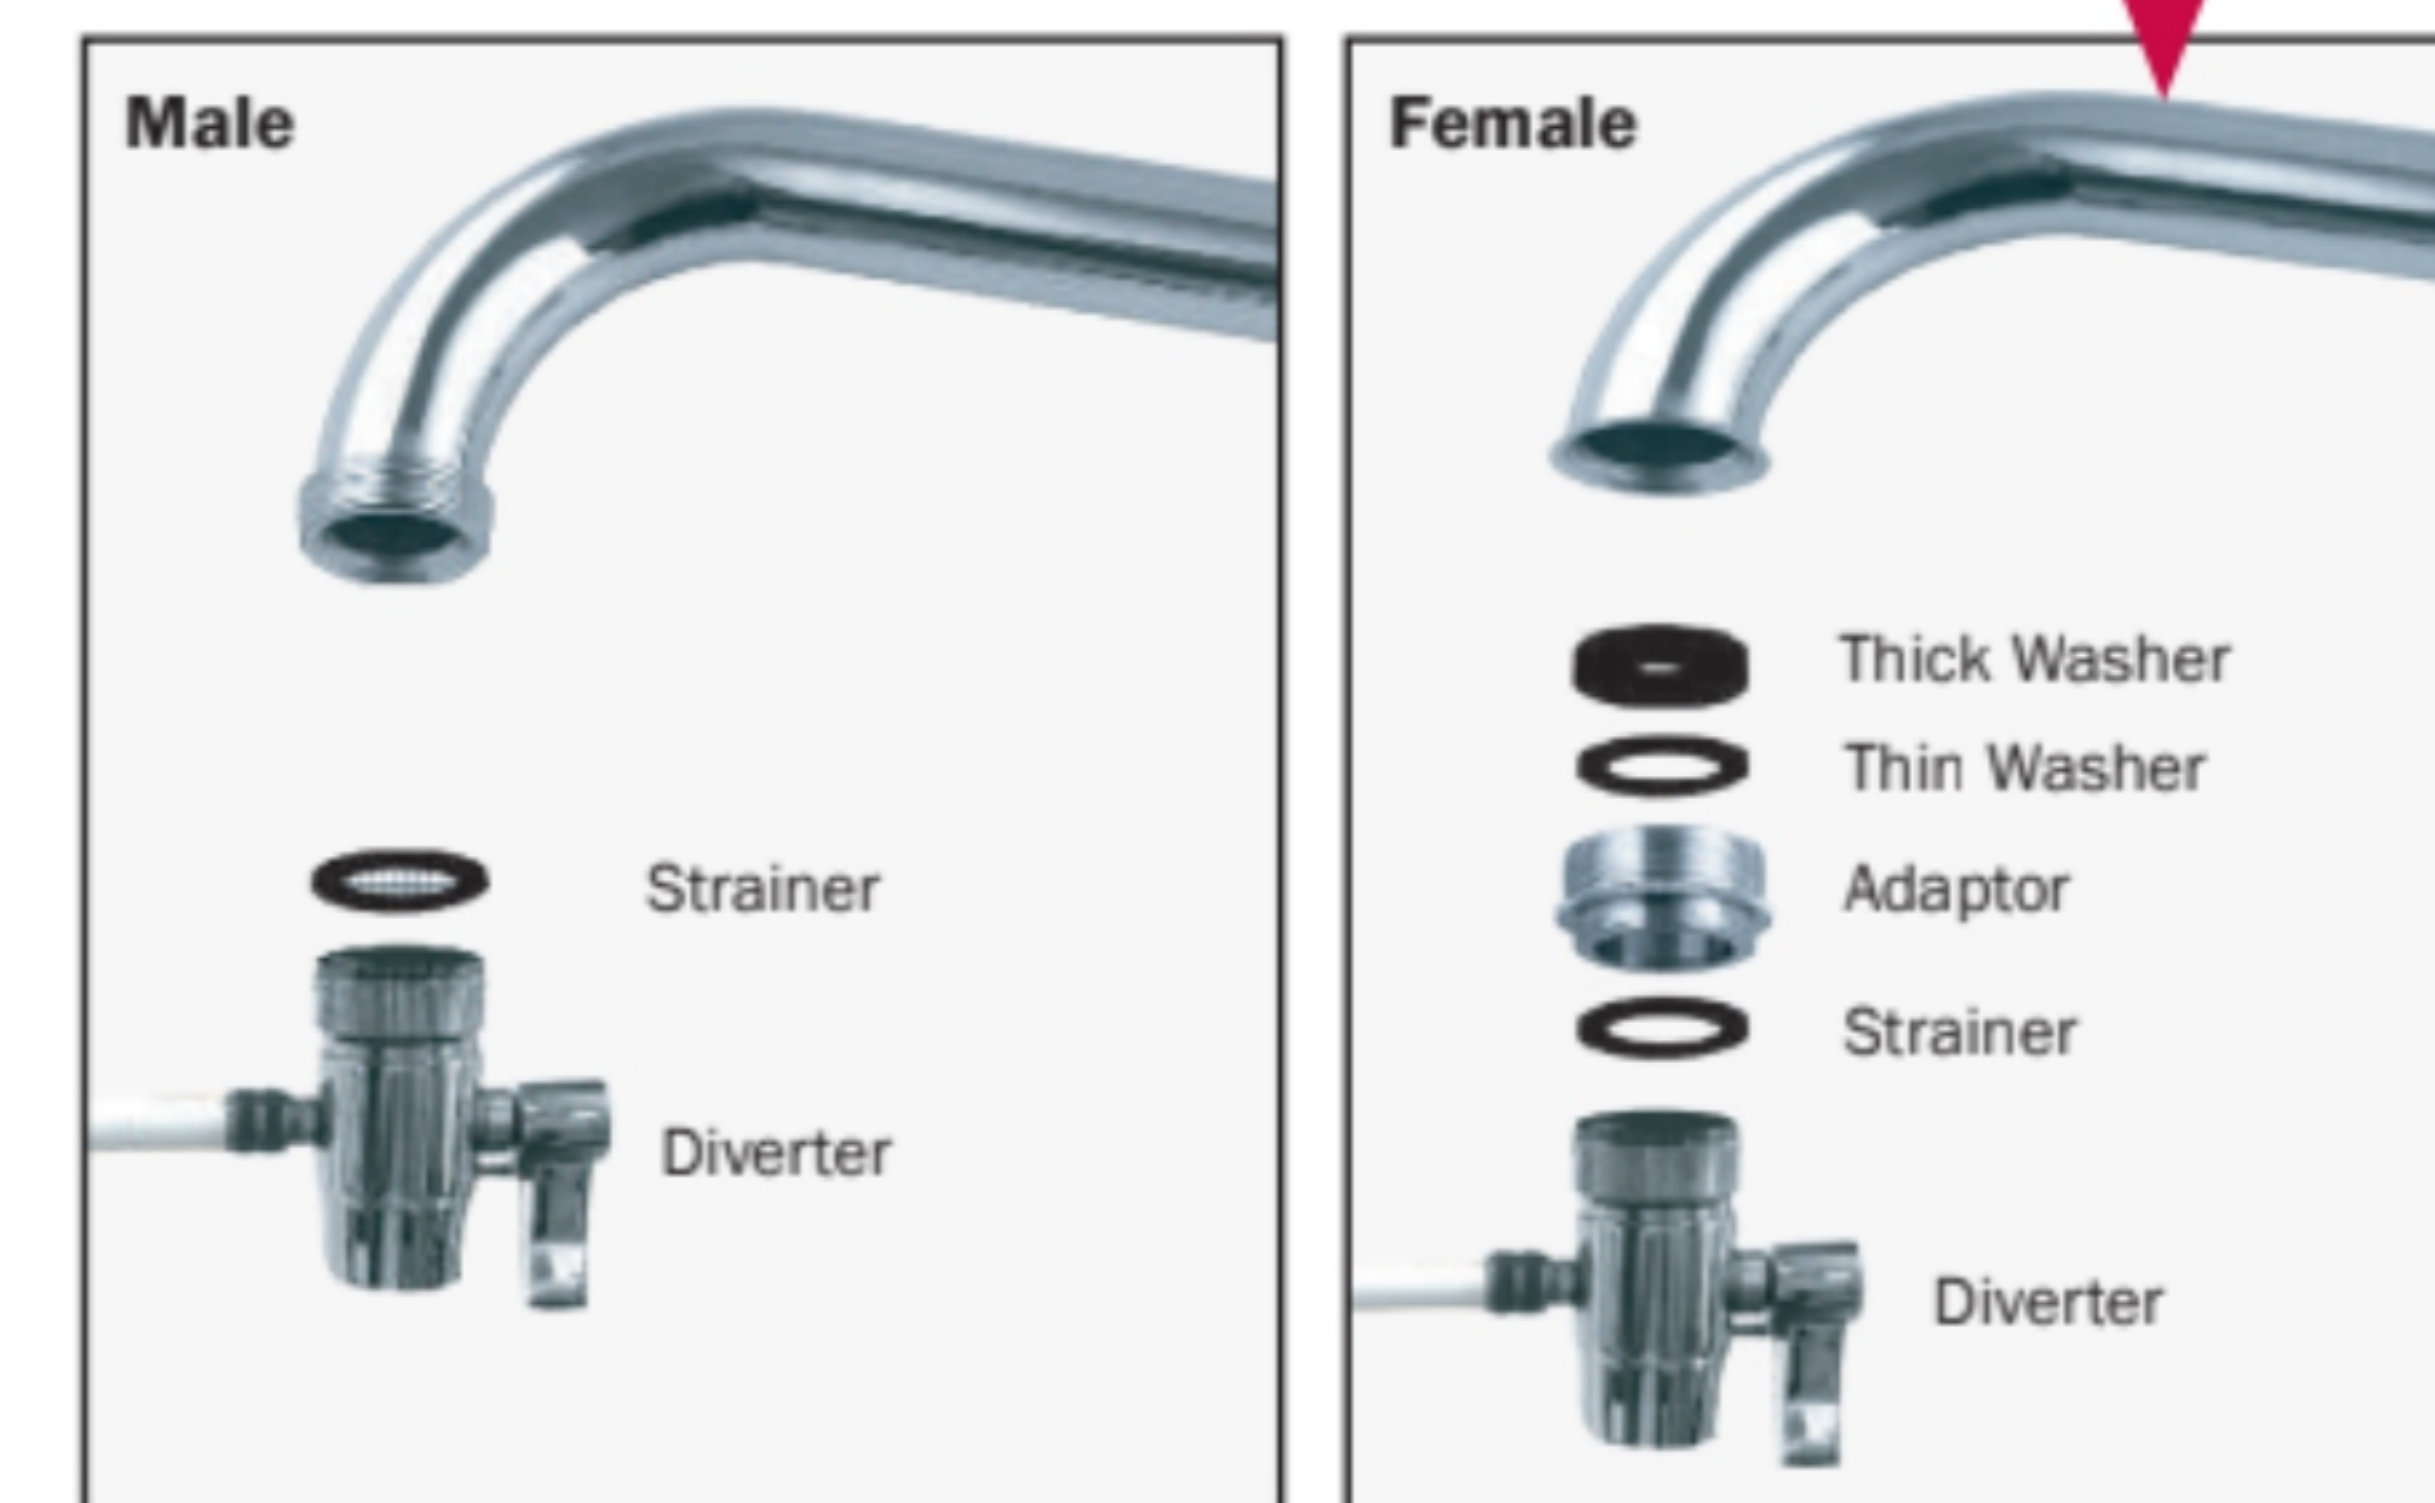

- Find a convenient countertop location to place the filter system in reach of your faucet.
- Unscrew the existing aerator from your faucet.
- An external thread indicates a male fitting, while an interior thread indicates a female fitting.
 - With a female fitting, first screw the standard adaptor, then the diverter.
 - With a male fitting, screw on the diverter.

To ensure optimal performance, hygiene and to prevent build up of contaminants, we recommend that filters are not used any longer than 12 months. However, replacement frequency depends on water quality and usage. Filters should also be changed when rated capacity is reached, or when flow becomes too slow.

Unlike an RO system, these systems will NOT reduce Total Dissolved Solids (TDS), or Calcium Hardness.

If you are interested in a filter that removes TDS or hardness, consider our Reverse Osmosis (RO) systems.

Components are Tested and Certified by NSF International under NSF/ANSI Standard 42 for material requirements only.